

P. = 5.7E-5

LEAK TEST COLD MASS 2182 (26-70)

Handwritten signature

CALIBRATION SYSTEM

LOG SCALE
1.0E-10

P.ATH.

2 mm/min

ZB 597

VACUUM H2 line

V. V2 line

Vessel

x line

H2 line

Pressure

26 bar

1.0E-6

1.0E-2

1.0E-8

6.65E-9

4.61E-9

3.45E-10

3.26E-8

2.87E-8

3.33E-7

6.72E-9

3.55E-10


6.50E-9

4.60E-9

3.40E-10

PRESSURE x line

VACUUM H2 line

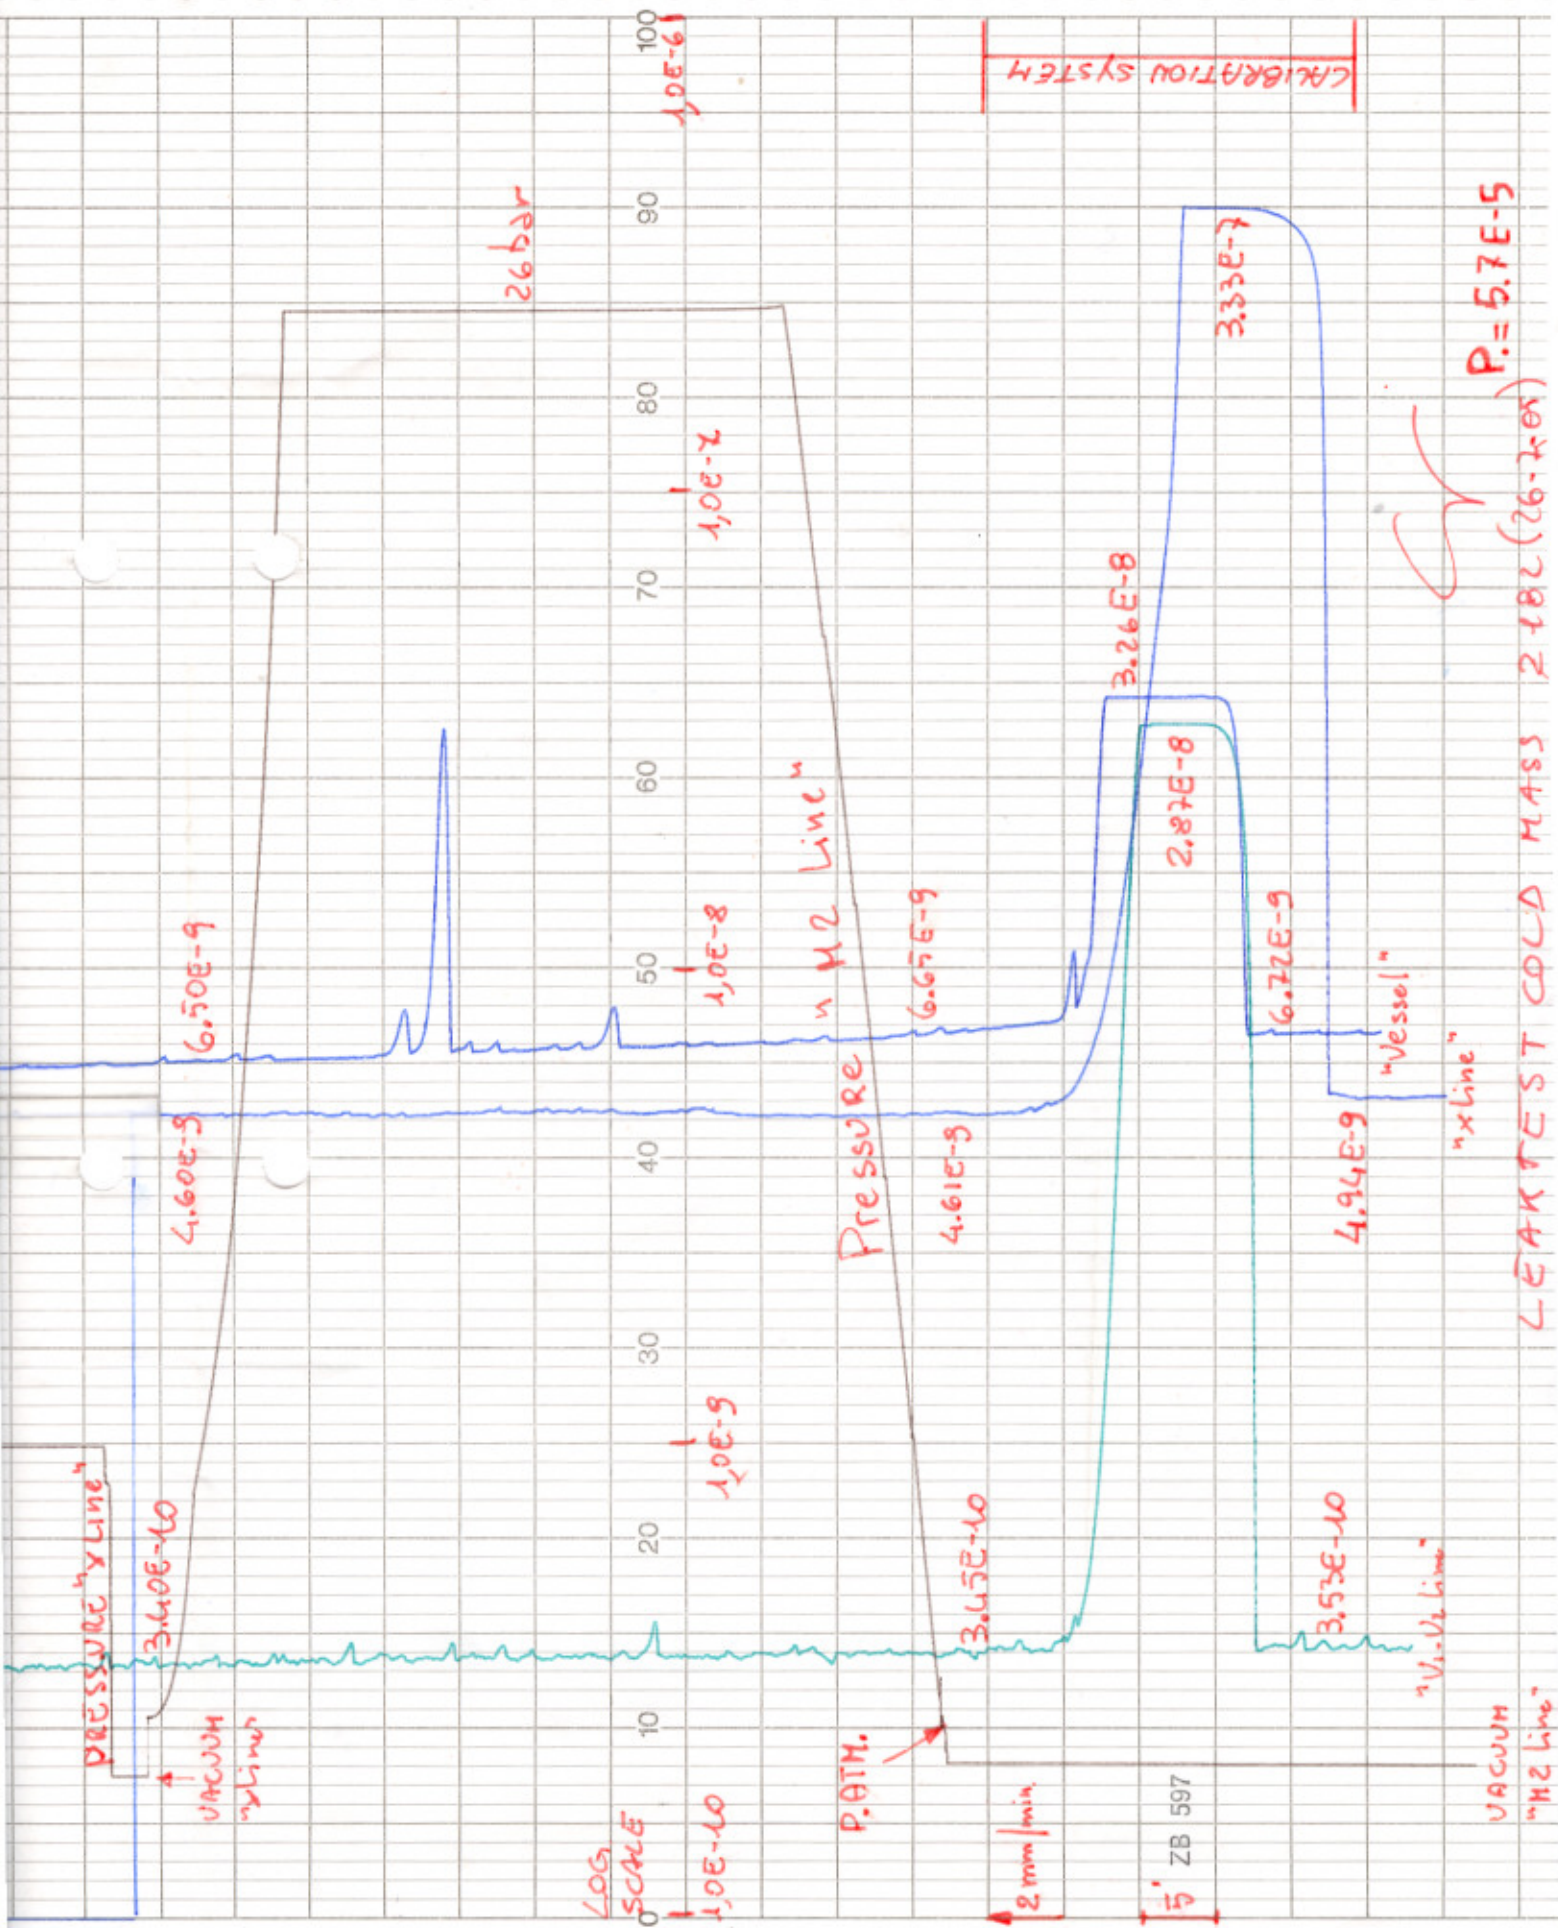

LEAK TEST COLD MASS 2182 (26-7-01)

