

LEAK TEST COLD MASS 2176 (26-04-07)

P. = 5.7E-5

✓

VACUUM
 "x line"

LOG
 SCALE
 1.0E-10


P.ATH.

2 mm/min

5 ZB 597

VACUUM
 "H2 line"

CALIBRATION SYSTEM

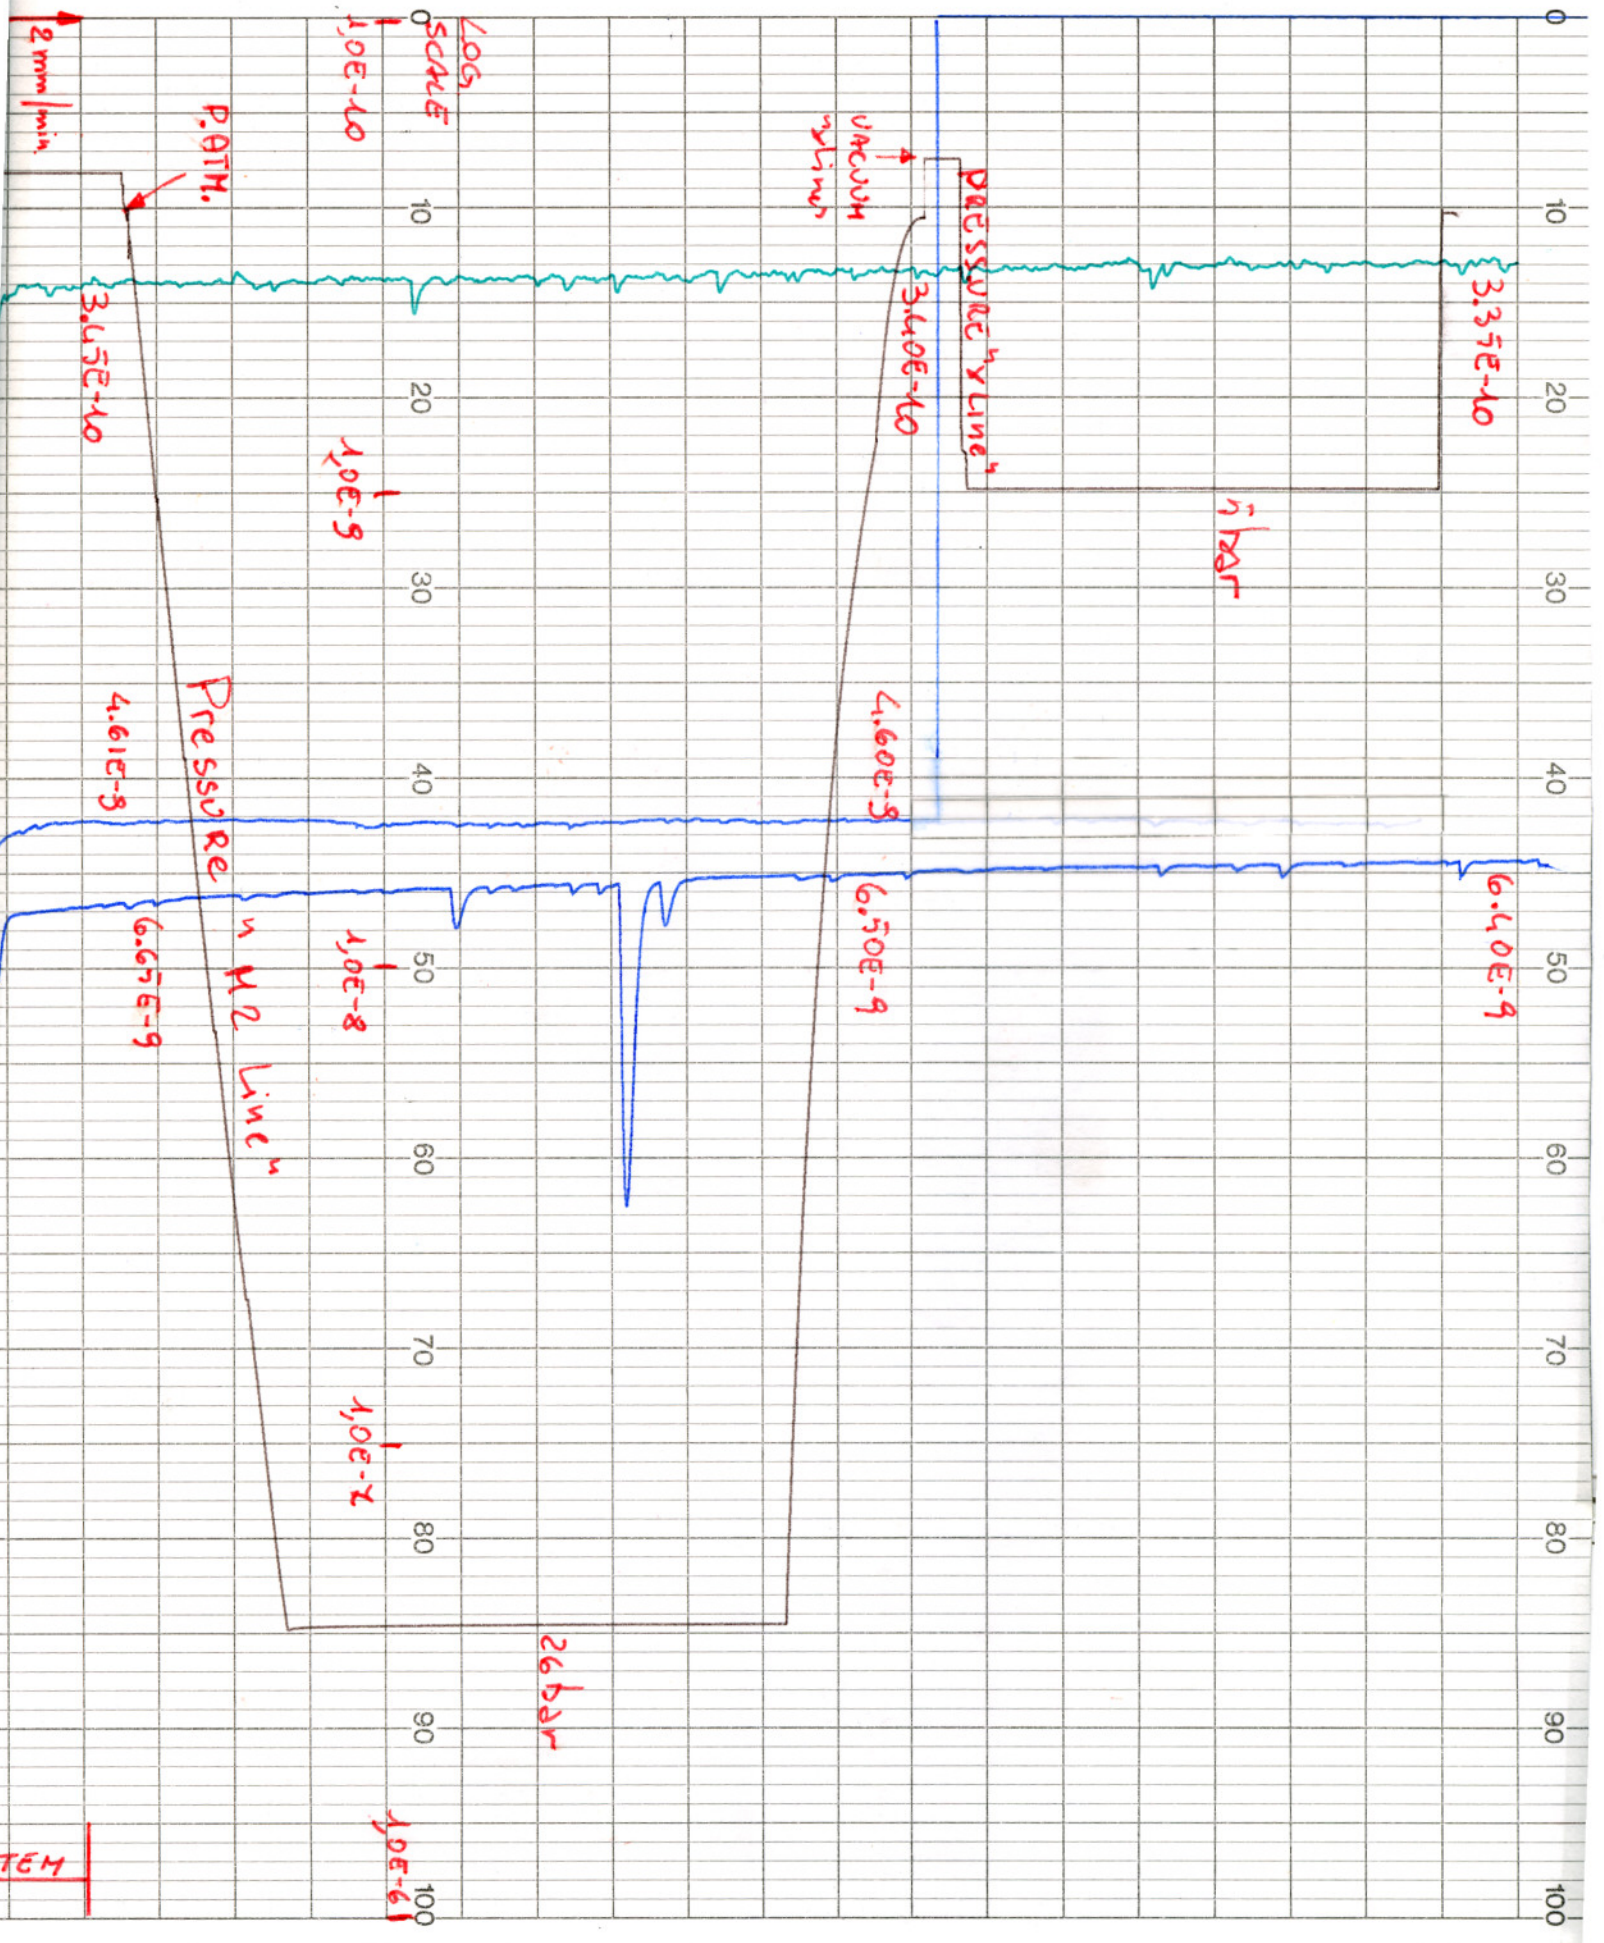

SYSTEM