


LEAK TEST COLO MASS 2277 (23-12-05) P. = 4.2E-7

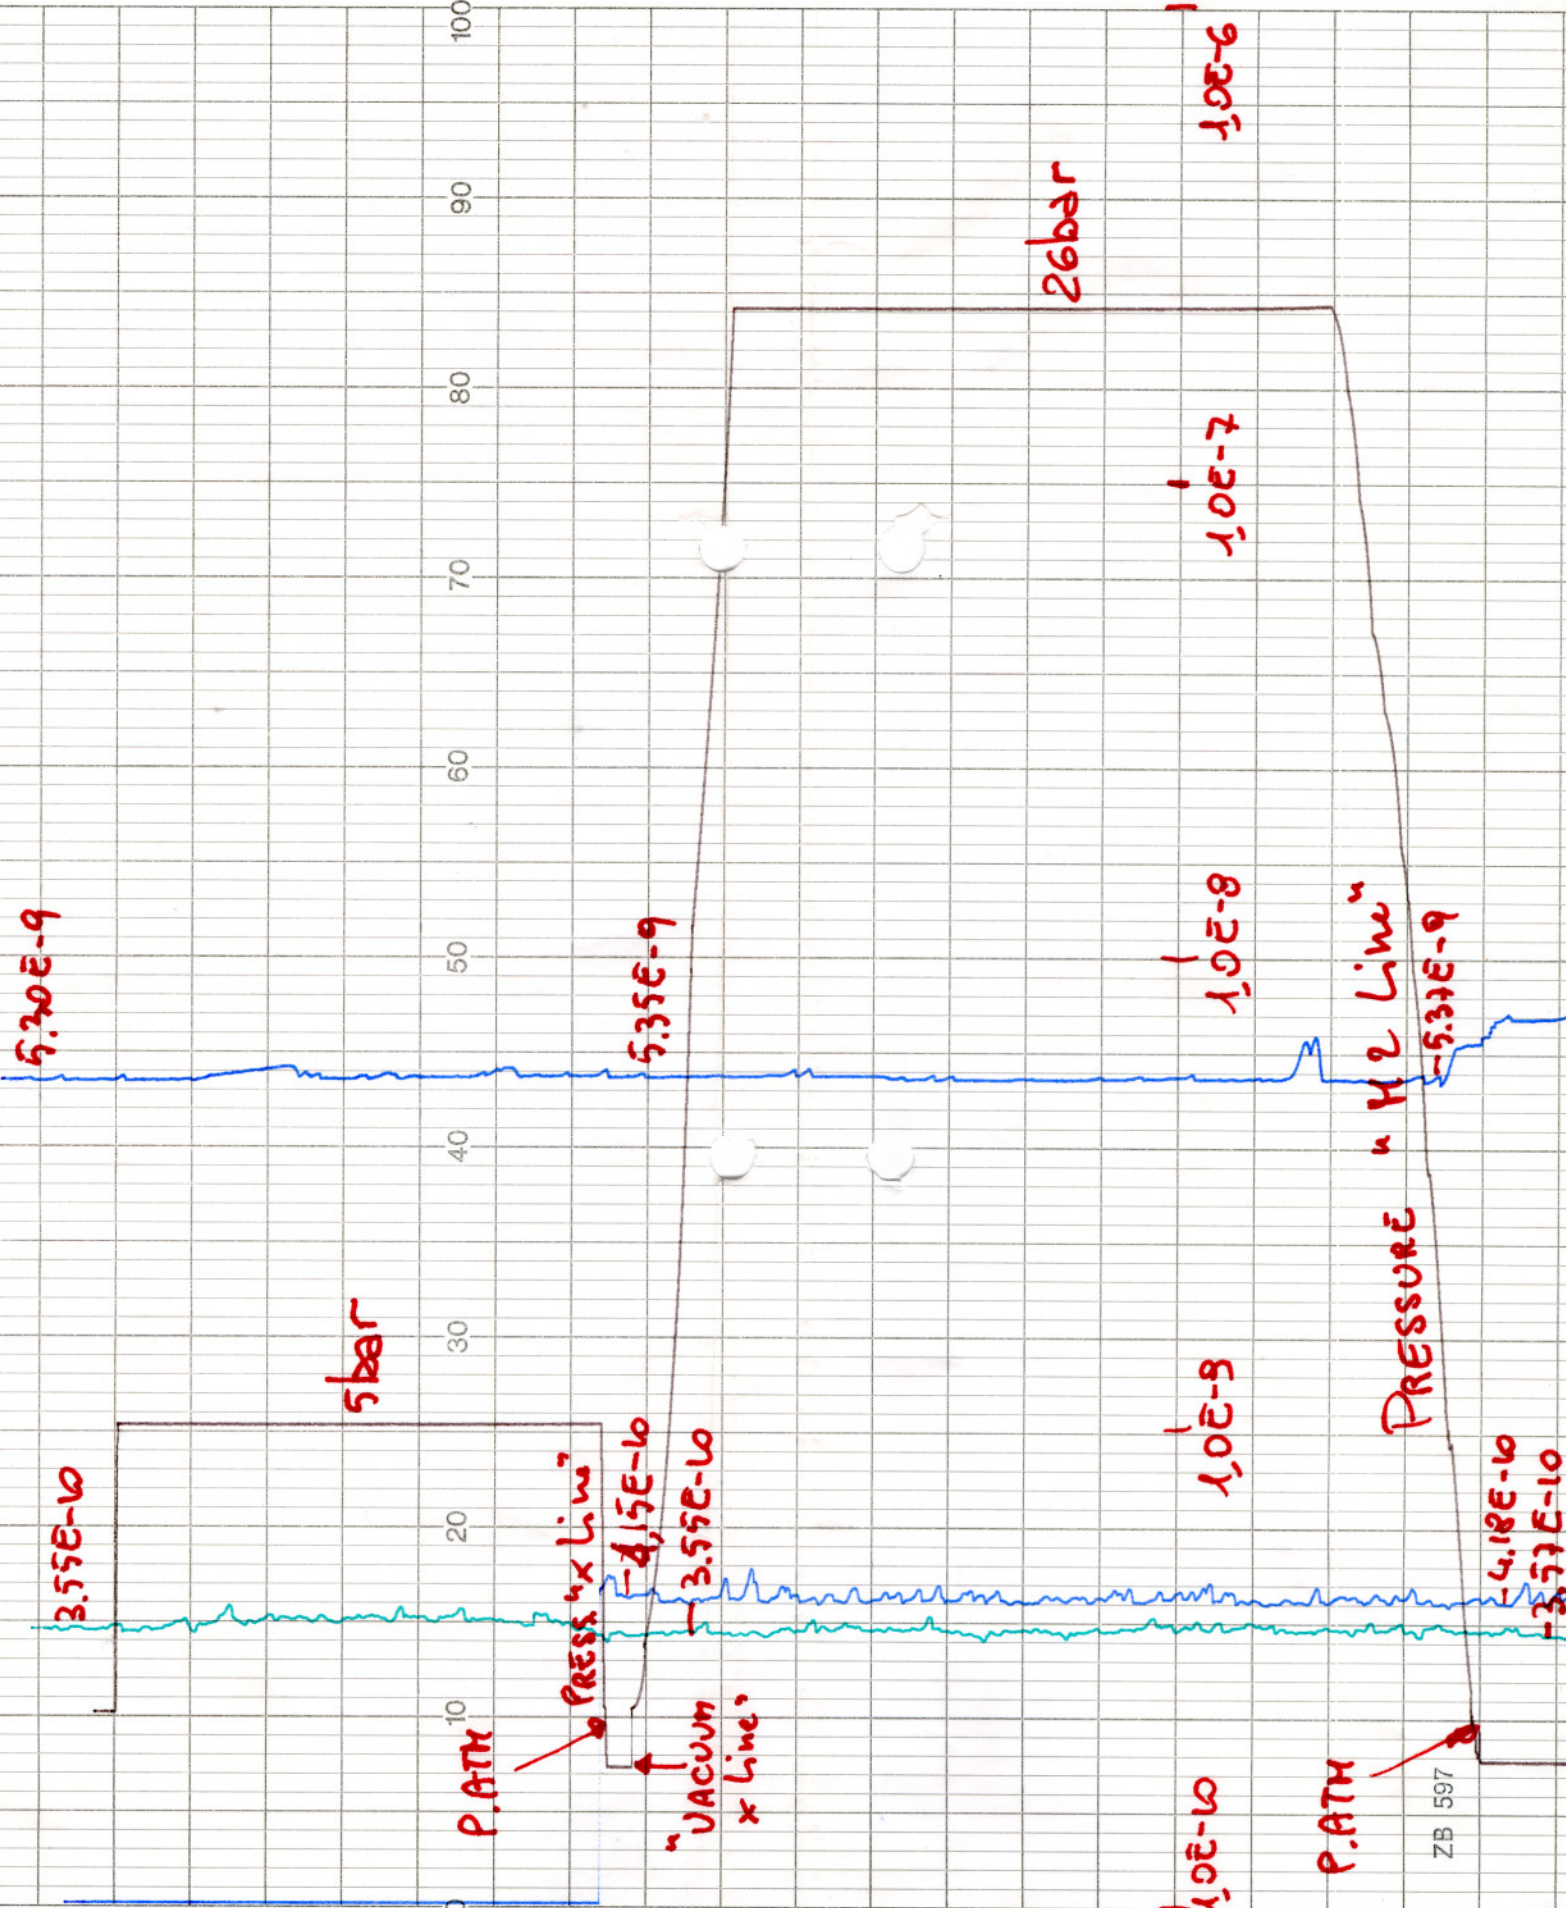

ZB 597